



PF

High Temperature Constant Wattage Heating Cable PF

Features

Outer jacket

- Stainless steel braided (SB).

Bus wire

- Tinned copper.

Maximum maintenance temperature (continuous)

- 93 °C (200 °F).

Maximum exposure temperature (intermittent)

- 204 °C (400 °F).

Nominal voltage

- See table Watts/ft. (m) at alternate voltages.

Bending radius, minimum

- 25 mm (1 in.).

Installation temperature, minimum

- -21 °C (-5 °F).

Approvals

- Ordinary locations: FM Approved for pipe tracing
- Hazardous locations: FM Approved for Class I, Division 2, Groups B, C, and D

Warranty

- 1-year basic warranty on the heating cable.

Application

- Freeze protection and process heating applications.





Models

Product # ¹	Volts	Nominal output		Amp.		Zone length ²		Max. circuit length ³	
		W/ft.	W/m	ft.	m	in.	cm	ft.	m
PF-3-SB	208	2.7	9	.013	.04	48	122	710	216
PF-6-SB	120	6.0	20	.050	.16	24	61	280	85
PF-7-SB	120	8.0	26	.067	.22	24	61	240	73
PF-8-SB	120	1.8	6	.015	.05	24	61	480	146
PF-10-SB	208	8.9	29	.043	.14	24	61	390	119
PF-12-SB	480	12.0	39	.025	.08	48	122	780	238

¹ Standard stainless steel braided.

² One complete heating zone is the distance between two successive bus connections.

³ Maximum circuit length is defined as the length of cable at which the heat output, due to voltage drop, decreases to 90 percent of the heat output at the power connection point.

Watts/ft. (m) at alternate voltages

Product #	120V	208V	240V	277V	480V
PF-3-SB	-	3 (9)	4 (12)	5 (16)	-
PF-6-SB	6 (20)	-	-	-	-
PF-7-SB	8 (26)	-	-	-	-
PF-8-SB	2 (6)	5 (18)	7 (23)	9 (13)	-
PF-10-SB	3 (10)	9 (29)	12 (39)	-	-
PF-12-SB	-	-	3 (10)	4 (13)	12 (39)

Zone marker:

Zone Markers for PF series cable may be raised bumps, or depressions on the edge of the cable. (Braid may have to be pulled away to locate.)

Use of ground fault protective devices and metallic overshield

NEC CODE 2017, ARTICLE 427-22:

Equipment Protection. Ground-fault protection of equipment shall be provided for electric heat tracing and heating panels. This requirement shall not apply in industrial establishments where there is alarm indication of ground faults and the following conditions apply:


- (1) Conditions of maintenance and supervision ensure that only qualified persons service the installed systems.
- (2) Continued circuit operation is necessary for safe operation of equipment or processes.

NEC CODE 2017, ARTICLE 427-23:

Grounded Conductive Covering. Electric heating equipment shall be listed and have a grounded conductive covering in accordance with 427.23(A) or (B). The conductive covering shall provide an effective ground path for equipment protection.

- (a) Heating Wires or Cables. Heating wires or cables shall have a grounded conductive covering that surrounds the heating element and bus wires, if any, and their electrical insulation.

Product description code (example)

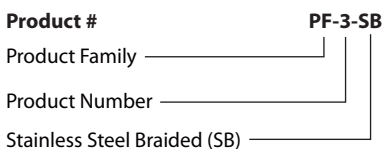

The material contained in this document is presented in good faith and believed to be reliable and accurate. However, because testing conditions may vary and material quality or information that may be provided in whole or in part by others may be beyond our control, no warranty, expressed or implied, is given. Delta-Therm can assume no liability for results obtained or damages incurred through the application of the data and tests presented.

Accessories

See Accessories section.